



Scale: 1 inch= 250 Ft.


Luminaire Schedule							
Symbol	Qty	Label	Arrangement	Lumens	Lum. Watts	LLF	Description
	37	A	SINGLE	2654	28.2	0.850	Core Cage, No Panels, 16 LED, 530mA, 4K, Type III, 12ft Pole
	10	B	SINGLE	5308	55	0.850	Core Cage, No Panels, 32 LED, 530mA, 4K, Type III, 14ft Pole
	4	C	SINGLE	6784	76	0.850	Core Cage, No Panels, 32 LED, 700mA, 4K, Type V, 14ft Pole

Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Description	
Amenity Parking	Illuminance	Fc	0.93	3.7	0.2	4.65	18.50	10ft Grid	
Clubhouse Parking	Illuminance	Fc	0.86	3.2	0.2	4.30	16.00	10ft Grid	
Roads	Illuminance	Fc	0.09	2.14	0.00	N.A.	N.A.	15ft Grid	

Project #:	Revision #:	Date:	Project:	Rev. #	Description	Rev. Date
501-19975	R1	12/20/2016	Westtown Residential Development	R1	Added three locations	12/28/16
Created By:	Size:	Page #:	Author:	R2		
P. Dugan	ARCH D	Page 1 of 5	Babara Petrella	R3		
			Specifier:	R4		
			Emily Stewart	R5		

Disclaimer: Philips Lighting Inc. is not responsible for the accuracy of the data provided for this project. Actual measured values may differ from forecasted results due to tolerances in calculation methods, testing procedures, component procedures, component performance, measurement techniques and varying conditions and improper or undocumented lamp burn-in procedures. Further, room dimensions, reflectance, furniture and architectural elements within the space may significantly affect calculations. Philips Lighting Inc. is not the responsibility of Philips Lighting Inc. and shall be the responsibility of the architect, owner, or owners representative, as applicable. Please refer to Luminaire Schedule for light fixture factor (LFF) values used in this calculation.

Scale: 1 inch= 80 Ft.

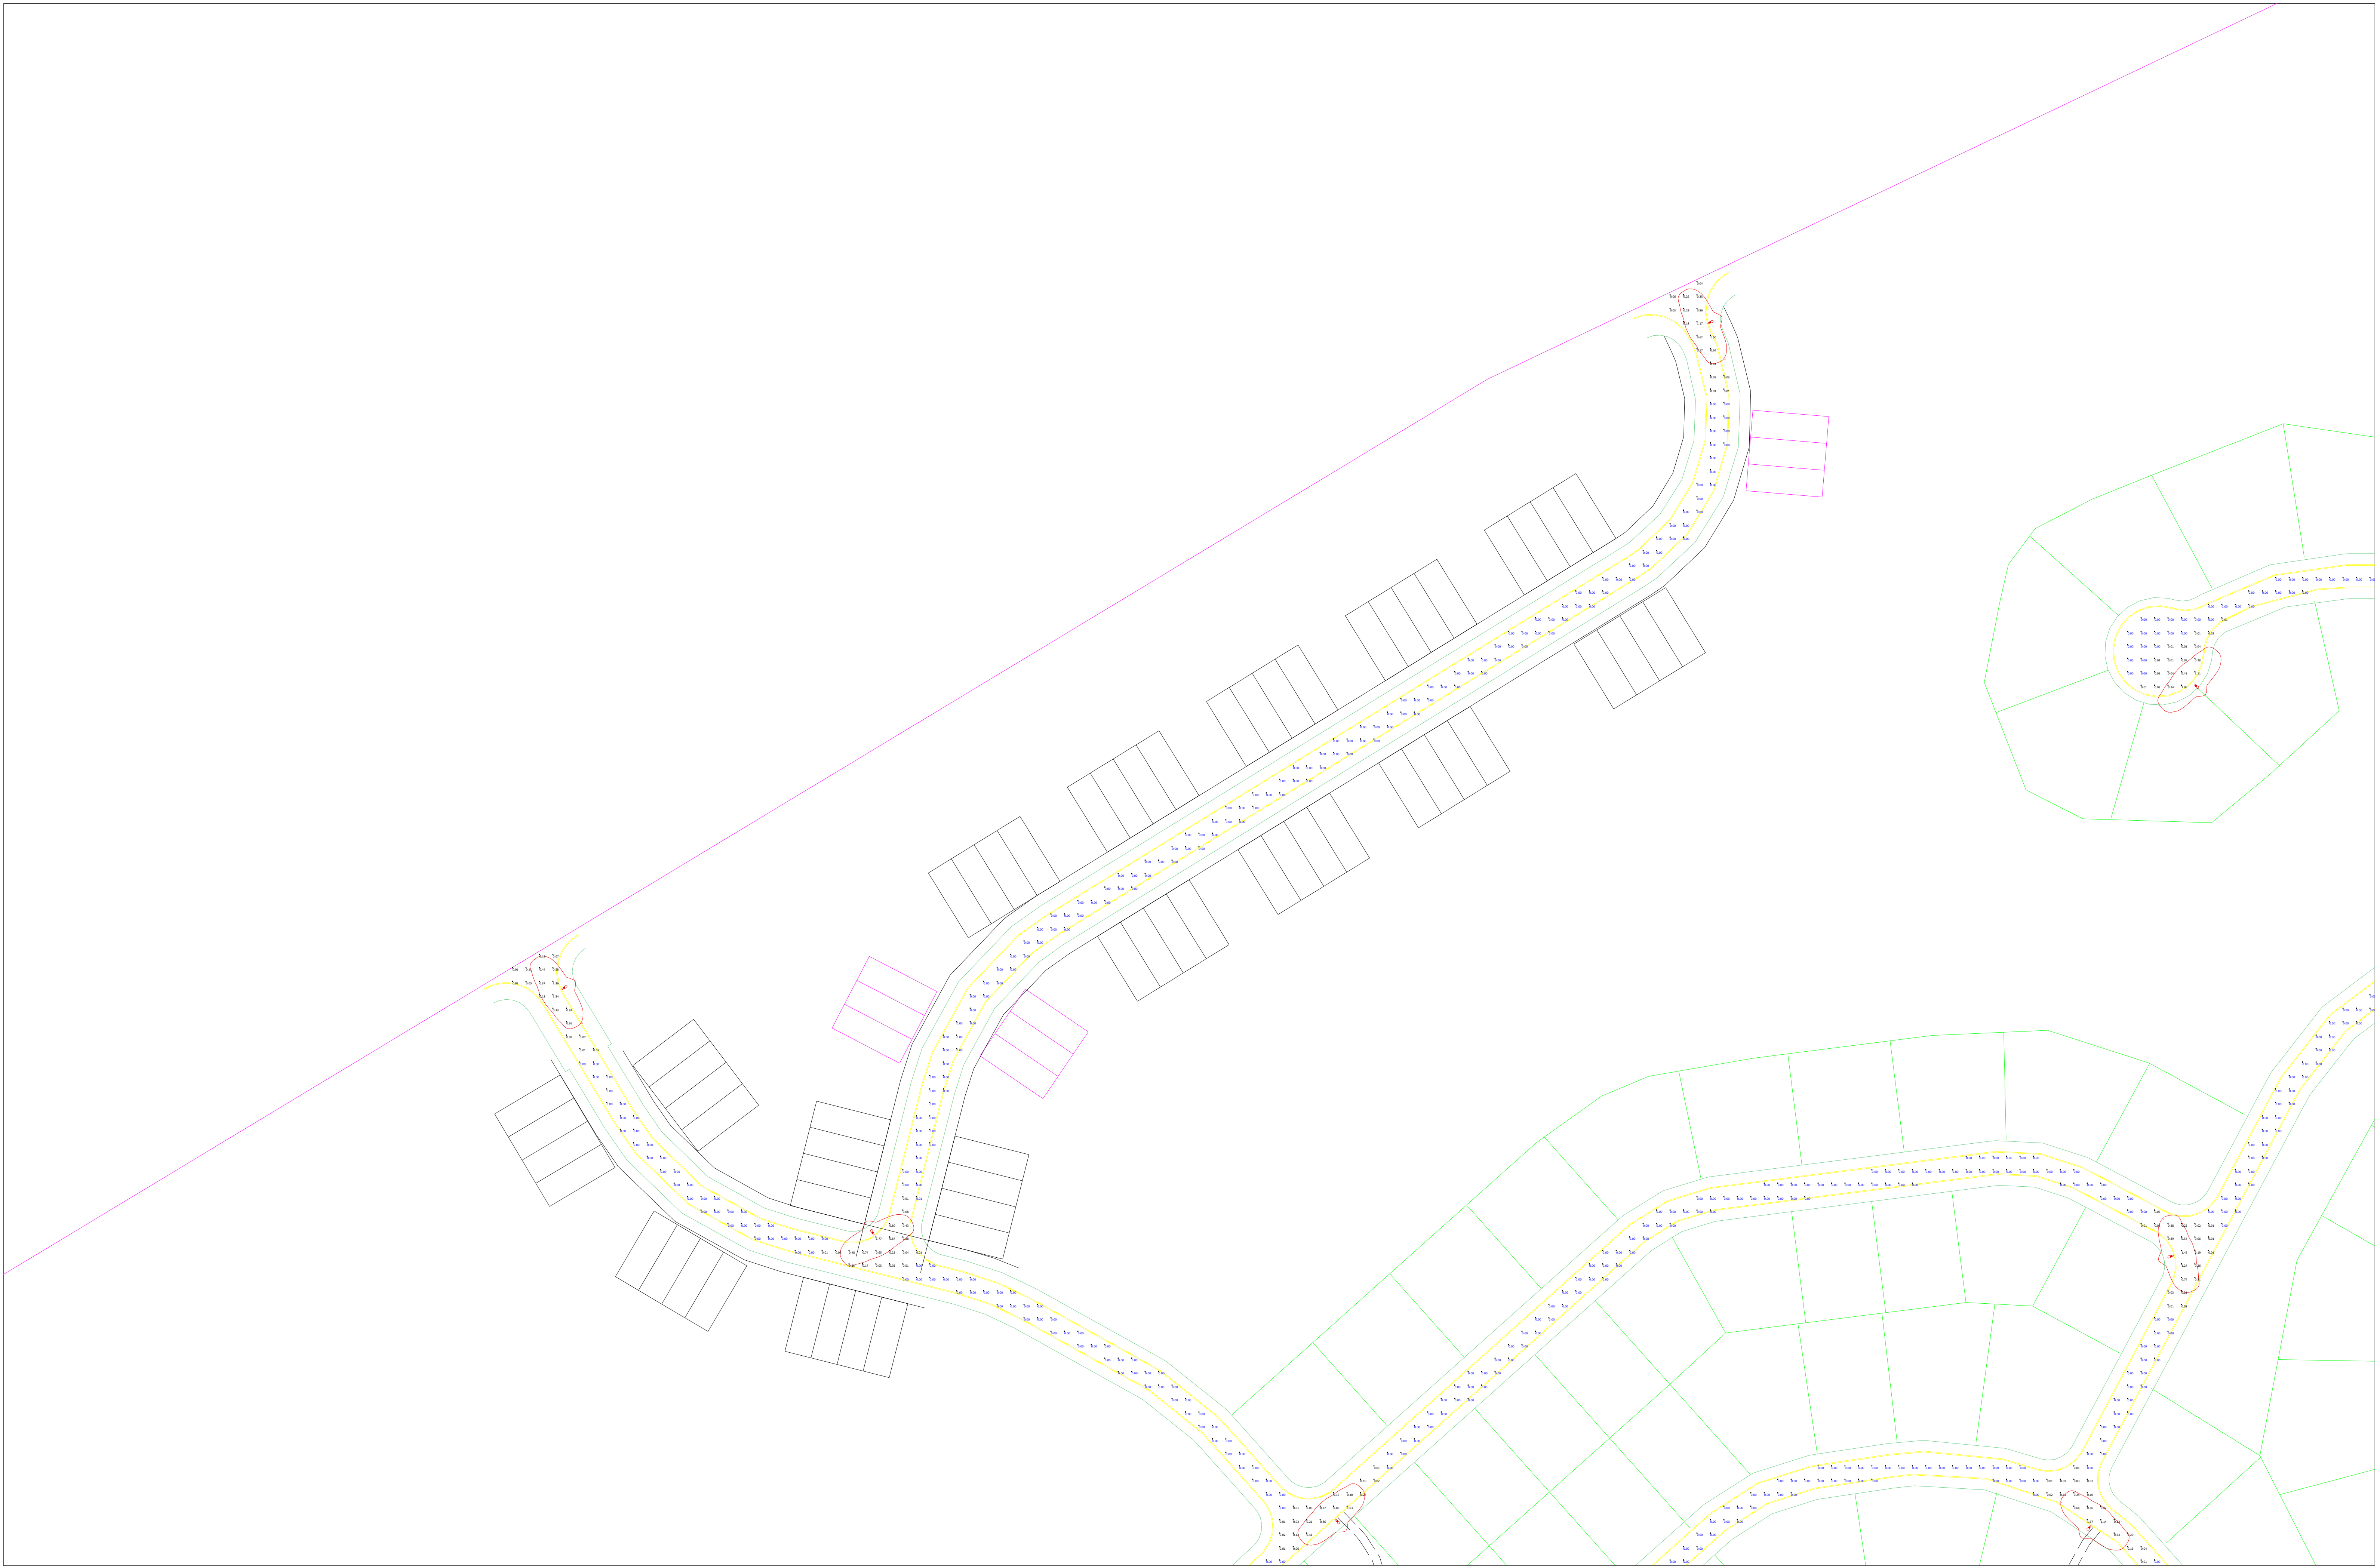


24" x 36"

Disclaimer: Philips Lighting Inc. is not responsible for the accuracy of the data provided to Philips. Actual measured values may differ from forecasted results due to tolerances in calculation methods, testing procedures, component procedures, component performance, measurement techniques and varying conditions and improper or undocumented lamp burn-in procedures. Further, room dimensions, reflectors, furniture and architectural elements within the space may significantly affect calculations. Philips Lighting Inc. is not the responsibility of Philips, and shall be the responsibility of the architect, reviewer, or owners representative, as applicable. Please refer to Luminaire Schedule for light fixture factor (LFF) values used in the calculations.


Rev. #	Description	Rev. Date
R1	Added three locations	12/28/16
R2		
R3		
R4		
R5		



Scale: 1 inch= 80 Ft.

 http://www.usa.lighting.philips.com indoorlighting_applications@philips.com outdoorlighting_applications@philips.com	Project #: 501-19975	Revision #: R1	Date: 12/20/2016	Project: Westtown Residential Development	Rev. # R1	Description Added three locations	Rev. Date 12/28/16	
	Created By: P. Dugan	Size: ARCH D	Page #: Page 3 of 5	Author: Barbara Petrella	R2
				Specifier: Emily Stewart	R3
					R4
					R5

Disclaimer: Philips Lighting Inc. is not responsible for the accuracy of the data provided to Philips. Actual or measured values may differ from forecasted results due to tolerances in calculation methods, testing procedures, component performance, component performance, measurement techniques and varying conditions and improper or undocumented lamp burn-in procedures. Further, room dimensions, reflectance, furniture and architectural elements within the space may significantly affect calculations. Philips Lighting Inc. is not the responsibility of Philips, and shall be the responsibility of the architect, owner, or owners representative, as applicable. Please refer to Luminaire Schedule for light fixture (LUM) details used in the calculations.

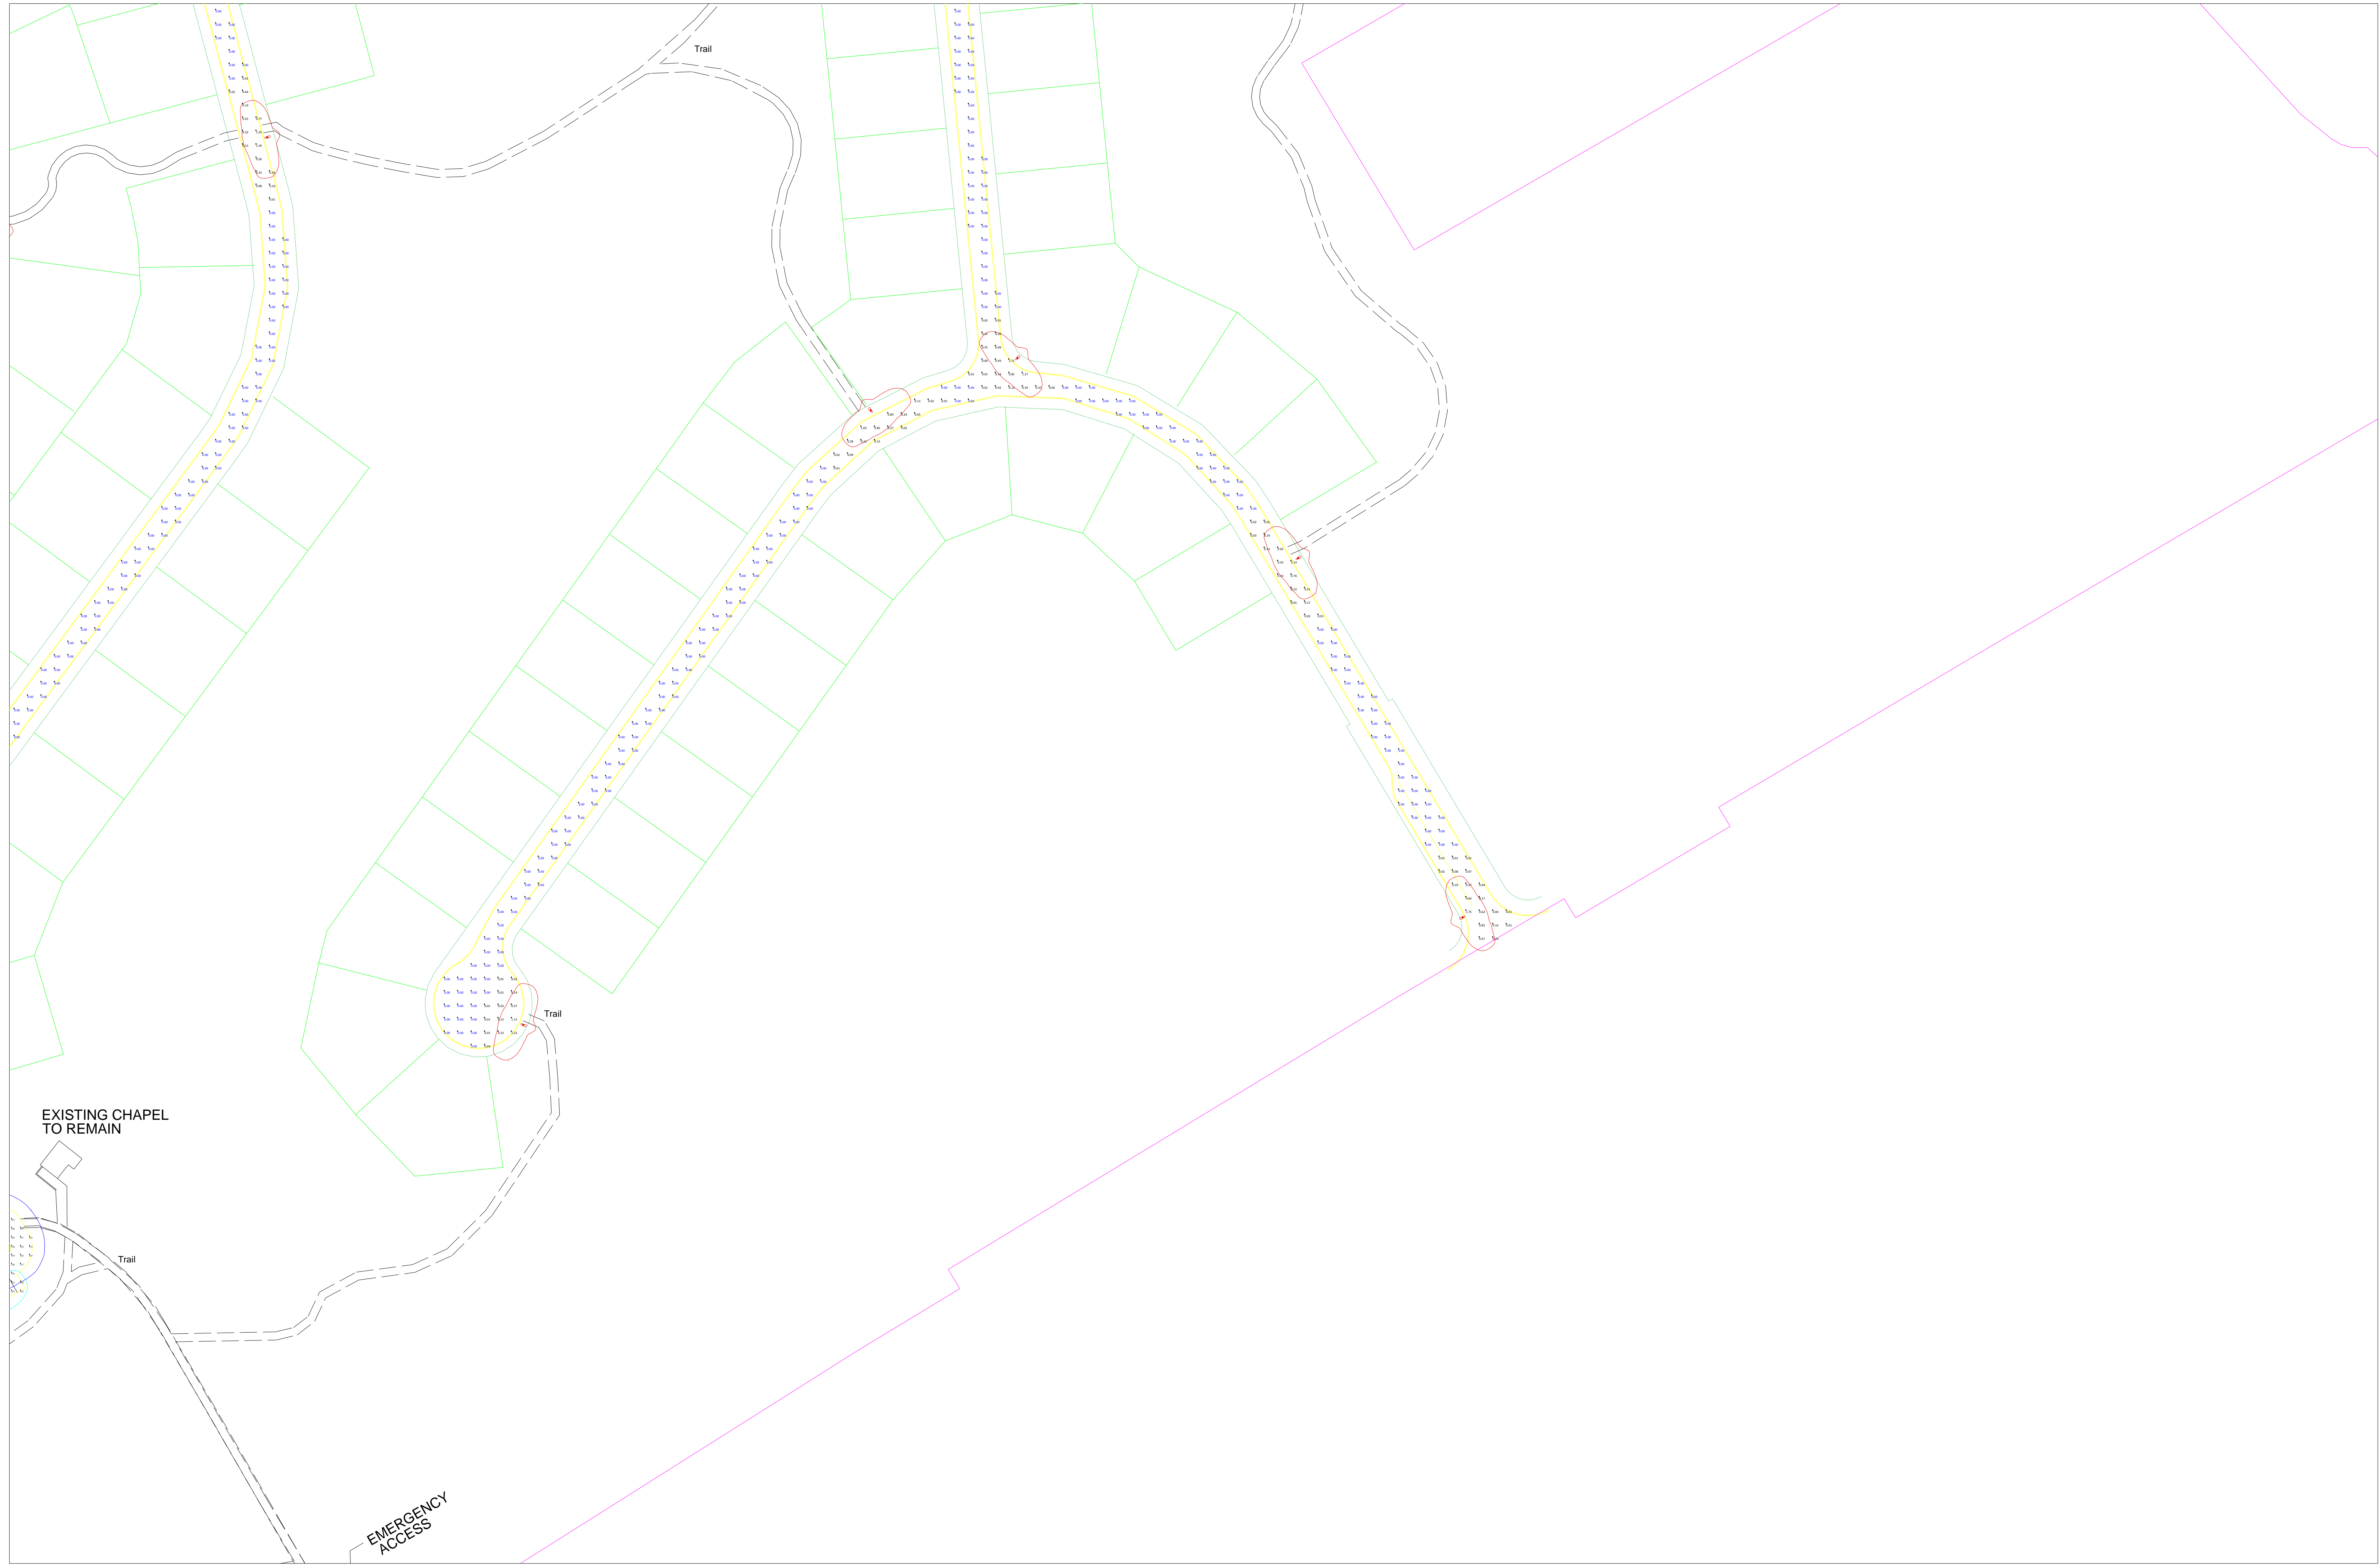

Scale: 1 inch= 80 Ft.

EMERGENCY ACCESS

PHILIPS http://www.usa.lighting.philips.com indoorlighting_applications@philips.com outdoorlighting_applications@philips.com	Project #: 501-19975	Revision #: R1	Date: 12/20/2016	Project: Westtown Residential Development Architect: Barbara Petrella Specifier: Emily Stewart	Rev. # R1 R2 R3 R4 R5	Description Added three locations	Rev. Date 12/28/16
	Created By: P. Dugan	Size: ARCH D	Page #: Page 5 of 5	Disclaimer: All work herein is based on project specifications provided to Philips. Actual or measured values may differ from forecasted results due to tolerances in calculation methods, testing procedures, component performance, measurement techniques and varying conditions and improper or undocumented lamp-in-procedures. Further, room dimensions, reflectance, furniture and architectural elements within the space may significantly affect calculations. Philips Lighting is not the responsibility of Philips, and shall be the responsibility of the architect, owner, or owners representative, as applicable. Please refer to Luminaire Schedule for light fixture Efficacy values used in this calculation.			